


- NOTE:-
1. ALL DIMENSIONS ARE IN MM.
 2. GRADE OF CONCRETE M30
 3. GRADE OF STEEL Fe-415 AS PER IS:1786-1985.
 4. THE GAPS BETWEEN COVER SLAB SHOULD BE FILLED WITH WATER PROOF MATERIAL .
 5. THE ERECTION OF HDPE PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON PIPE CONDUIT DIAMETER.
 6. THE ERECTION OF RCC NP4 PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON NUMBER OF PIPE CONDUITS.
 7. FINISHES FOR ALL INNER WALLS AND FLOOR SURFACES SHALL CONFORM TO U2 CLASS.
 8. ALL PIPE CONDUITS SHOULD BE CLOSED WITH HDPE DUMMIES


- NOTE:-
1. THIS INFORMATION MAY NOT CONTAIN ALL DETAILS REQUIRED FOR CONSTRUCTION.
 2. APPROPRIATE MODIFICATIONS MAY BE REQUIRED TO ENSURE SUITABILITY OF THIS DRAWING FOR THE SPECIFIC APPLICATION.

FOR TENDER DRAWINGS


Rev	Description	By	Verified	Date	Scales	Consultants	Client	Drawn	Project	Drawing Title	Drawing No	Rev
					AS SHOWN	aarvee associates architects engineers & consultants pvt. ltd.	Government of Andhra Pradesh Andhra Pradesh Amaravati Development Corporation Ltd. (ADCL)	SURYA	SMART INTEGRATED INFRASTRUCTURE MASTER PLAN AND DETAILED PROJECT REPORTS FOR PHASE-I INFRASTRUCTURE WORKS FOR/AT AMARAVATI CAPITAL CITY	TYPICAL MANHOLE DRAWINGS FOR POWER 33KV HDPE CONDUITS COMING IN MEDIAN	AG-1957-DDR-AM-PW-SD-MH-008	R0
R0	ISSUED FOR TENDER	MSP	KSP	03.08.2017	SCALES SHOWN ARE FOR AN A0 SIZE ORIGINAL DRAWING	GIIC 贵州海上丝路国际投资有限公司 GUOZHOU MARITIME SILK ROAD INTERNATIONAL INVESTMENT CORPORATION		Checked RAMARAJU Designed SUDHIR Approved KSSVV PRASAD Date 03.08.2017				

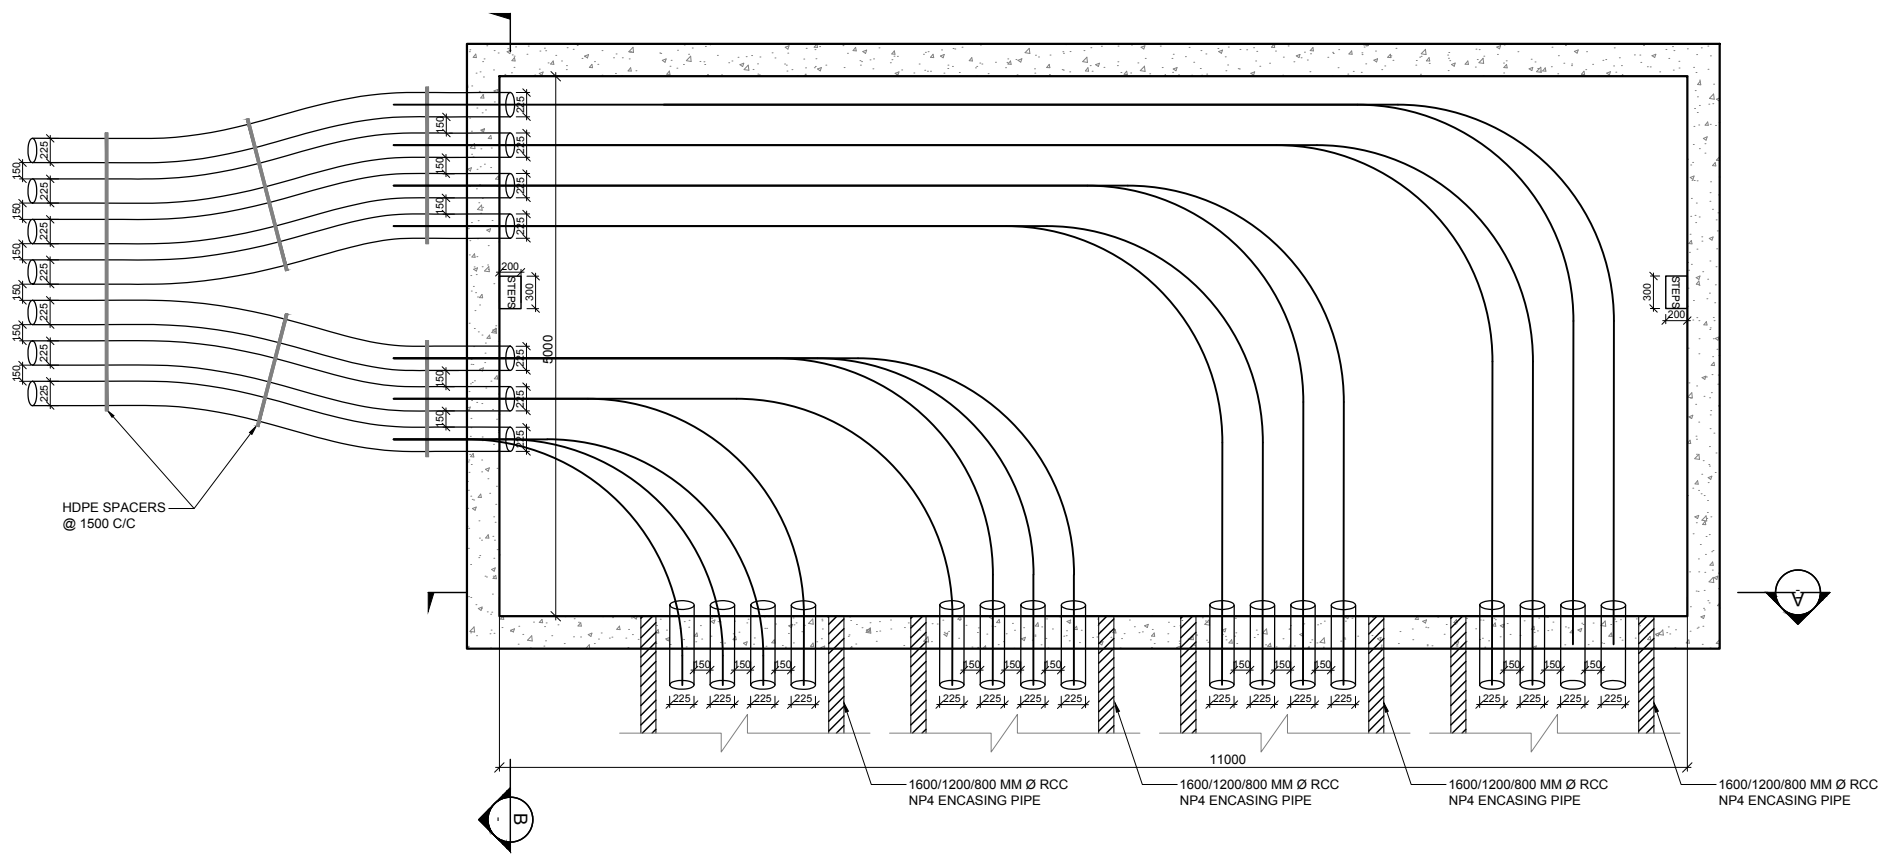


SCALE - 1:35
PLAN AT BOTTOM LEVEL



PLAN AT ROAD LEVEL
SCALE - 1:30



SECTION AT B-B
SCALE - 1:35



SECTION AT A-A
SCALE - 1:35

NOTE:-

1. ALL DIMENSIONS ARE IN MM.
2. GRADE OF CONCRETE M30
3. GRADE OF STEEL Fe-415 AS PER IS:1786-1985.
4. THE GAPS BETWEEN COVER SLAB SHOULD BE FILLED WITH WATER PROOF MATERIAL .
5. THE ERECTION OF HDPE PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON PIPE CONDUIT DIAMETER.
6. THE ERECTION OF RCC NP4 PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON NUMBER OF PIPE CONDUITS.
7. FINISHES FOR ALL INNER WALLS AND FLOOR SURFACES SHALL CONFORM TO U2 CLASS.
8. ALL PIPE CONDUITS SHOULD BE CLOSED WITH HDPE DUMMIES

NOTE:-

1. THIS INFORMATION MAY NOT CONTAIN ALL DETAILS REQUIRED FOR CONSTRUCTION.
2. APPROPRIATE MODIFICATIONS MAY BE REQUIRED TO ENSURE SUITABILITY OF THIS DRAWING FOR THE SPECIFIC APPLICATION.

FOR TENDER DRAWINGS

Rev	Description	By	Verified	Date	Scales	Consultants	Client	Drawn	Project	Drawing Title	Drawing No	Rev
					AS SHOWN	aarvee associates architects engineers & consultants pvt. ltd.	Andhra Pradesh Amaravati Development Corporation Ltd. (ADCL)	SURYA	SMART INTEGRATED INFRASTRUCTURE MASTER PLAN AND DETAILED PROJECT REPORTS FOR PHASE-I INFRASTRUCTURE WORKS FOR/AT AMARAVATI CAPITAL CITY	TYPICAL MANHOLE DRAWINGS FOR POWER 33KV HDPE CONDUITS COMING IN MEDIAN	AG-1957-DDR-AM-PW-SD-MH-009	R0
R0	ISSUED FOR TENDER	MSP	KSP	03.08.2017	SCALES SHOWN ARE FOR AN A0 SIZE ORIGINAL DRAWING	GVIC 贵州海上丝路国际投资有限公司 GUZHOUSHANGSILUJIAOYI INTERNATIONAL INVESTMENT CORPORATION		Checked RAMARAJU Designed SUDHIR Approved KSSVV PRASAD Date 03.08.2017				

NOTE:-

1. ALL DIMENSIONS ARE IN MM.
2. GRADE OF CONCRETE M30
3. GRADE OF STEEL Fe-415 AS PER IS:1786-1985.
4. THE GAPS BETWEEN COVER SLAB SHOULD BE FILLED WITH WATER PROOF MATERIAL .
5. THE ERECTION OF HDPE PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON PIPE CONDUIT DIAMETER.
6. THE ERECTION OF RCC NP4 PIPES IN SIDE WALLS SHOULD BE DECIDED BASED ON NUMBER OF PIPE CONDUITS.
7. FINISHES FOR ALL INNER WALLS AND FLOOR SURFACES SHALL CONFORM TO U2 CLASS.
8. ALL PIPE CONDUITS SHOULD BE CLOSED WITH HDPE DUMMIES

NOTE:-

1. THIS INFORMATION MAY NOT CONTAIN ALL DETAILS REQUIRED FOR CONSTRUCTION.
2. APPROPRIATE MODIFICATIONS MAY BE REQUIRED TO ENSURE SUITABILITY OF THIS DRAWING FOR THE SPECIFIC APPLICATION.

FOR TENDER DRAWINGS

Rev	Description	By	Verified	Date	Scales	Consultants	Client	Drawn	Project	Drawing Title	Drawing No	Rev
					AS SHOWN	 aarvee associates architects engineers & consultants pvt. ltd.	 Andhra Pradesh Amaravati Development Corporation Ltd. (ADCL)	Drawn	SMART INTEGRATED INFRASTRUCTURE MASTER PLAN AND DETAILED PROJECT REPORTS FOR PHASE-I INFRASTRUCTURE WORKS FOR/AT AMARAVATI CAPITAL CITY	TYPICAL MANHOLE DRAWINGS FOR POWER 33KV HDPE CONDUITS COMING IN MEDIAN	AG-1957-DDR-AM-PW-SD-MH-010	R0
								Checked				
								Designed				
								Approved				
								Date				
R0	ISSUED FOR TENDER	MSP	KSP	03.08.2017	SCALES SHOWN ARE FOR AN A0 SIZE ORIGINAL DRAWING	 贵州海上丝路国际投资有限公司 GUOZHONGHAI SILK ROAD INTERNATIONAL INVESTMENT CORPORATION JV		03.08.2017				